


THIS DRAWING IS THE PROPERTY OF HYDRO-BLAST. ALL RIGHTS OF DESIGN OR INVENTION RESERVED. REPRODUCTIONS ARE FORBIDDEN WITHOUT WRITTEN CONSENT.

ABUNDANT ENERGY

ARE442-HV (240V GRID) ELECTRICAL WIRING DIAGRAM

REV E

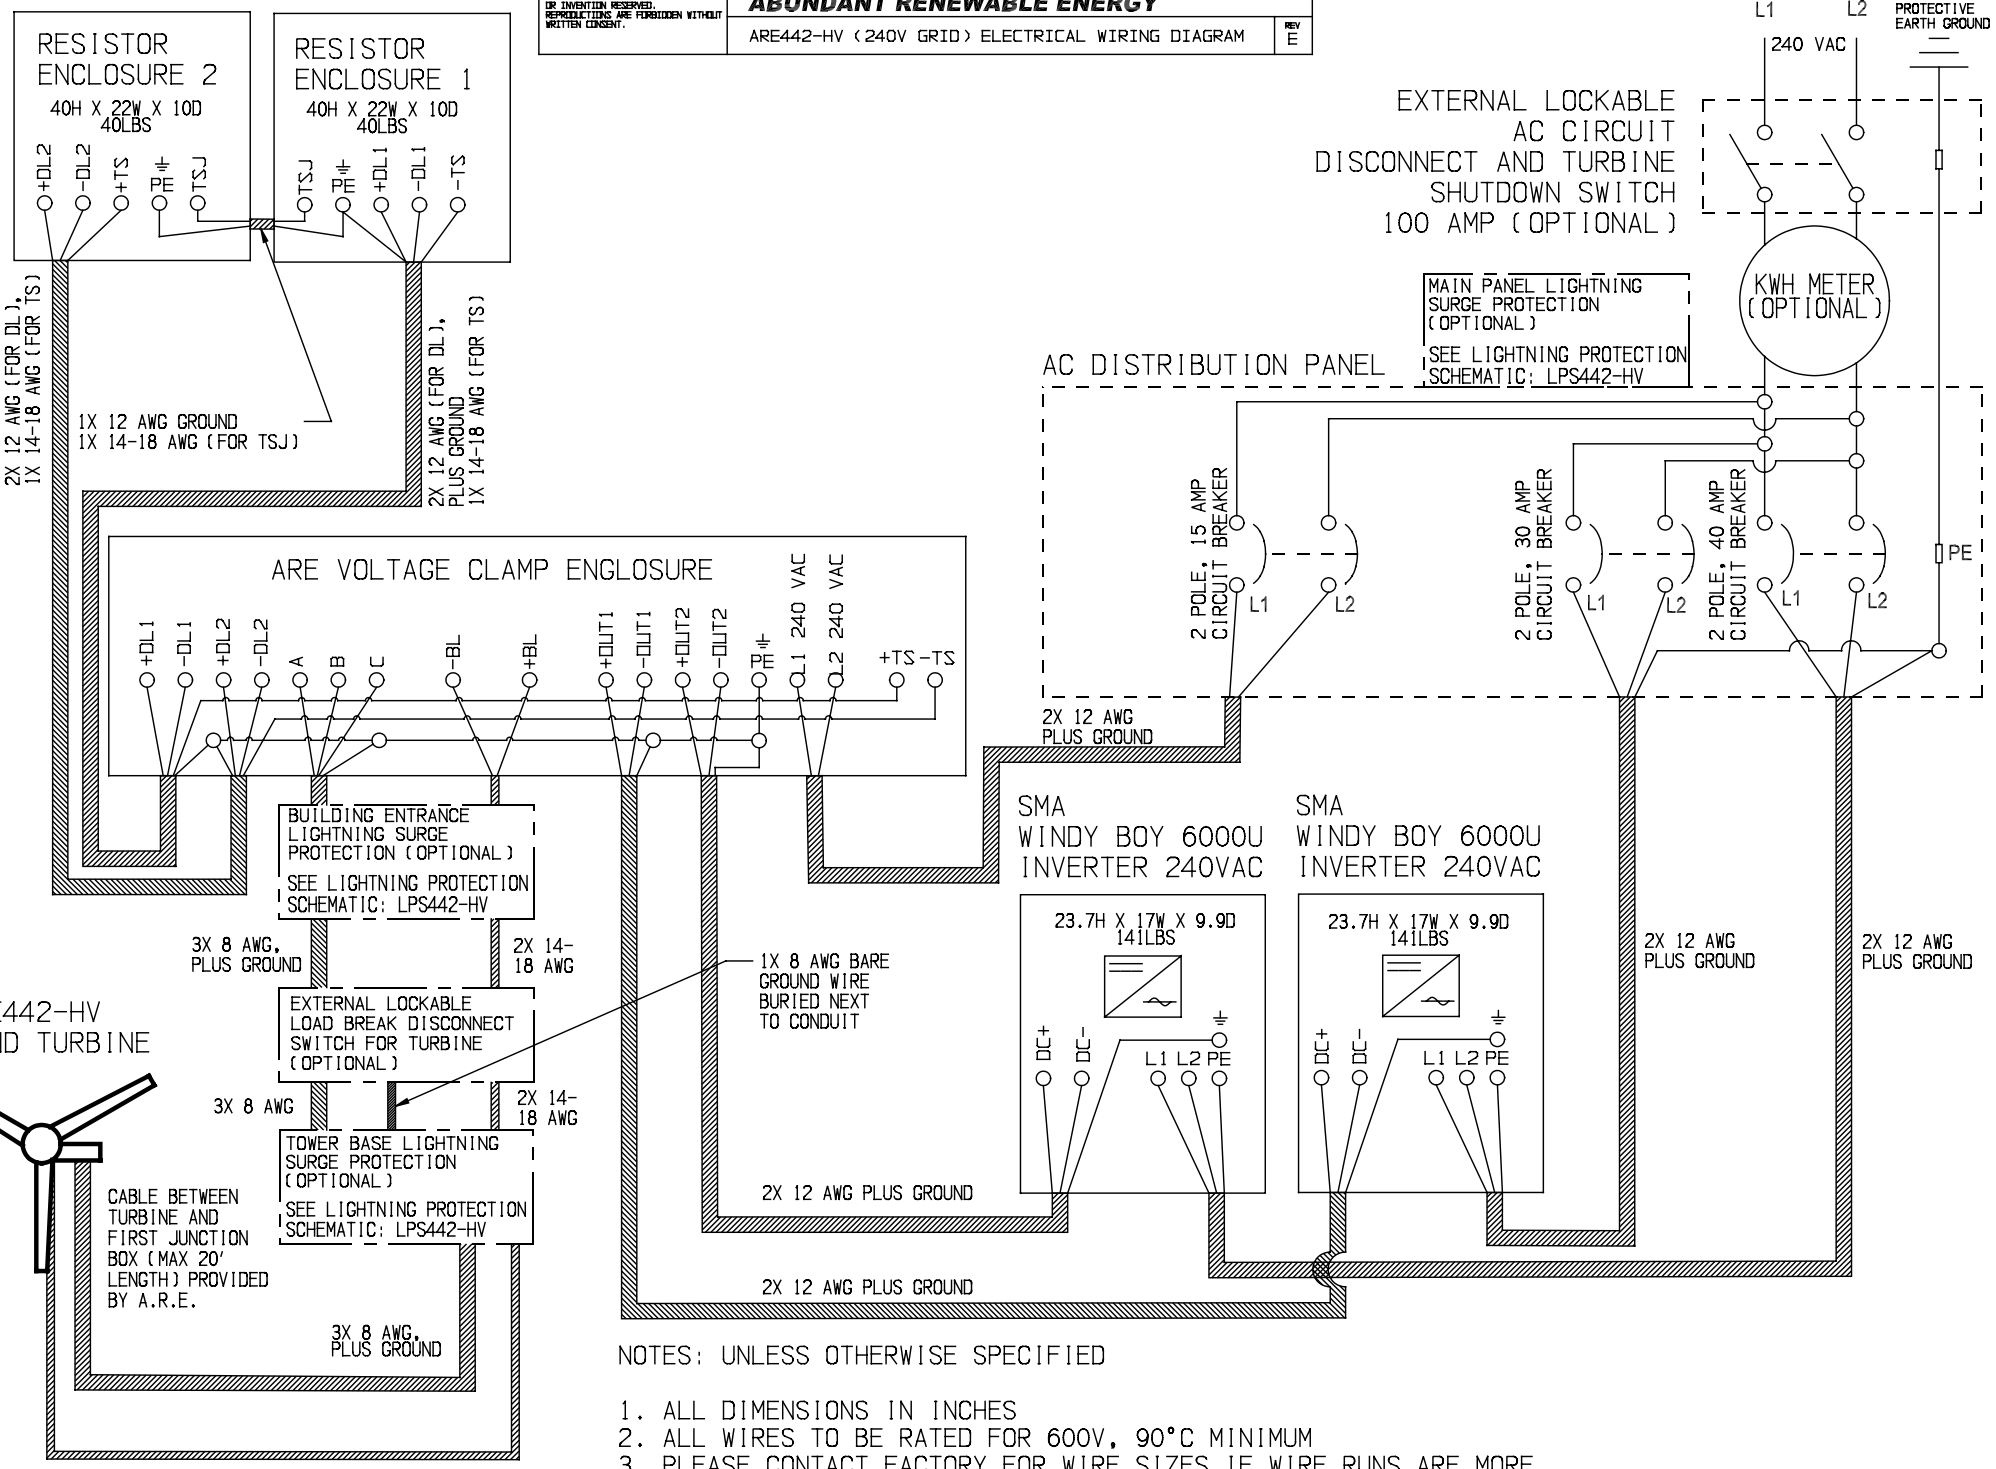

NOTES: UNLESS OTHERWISE SPECIFIED

1. ALL DIMENSIONS IN INCHES
2. ALL WIRES TO BE RATED FOR 600V, 90°C MINIMUM
3. PLEASE CONTACT FACTORY FOR WIRE SIZES IF WIRE RUNS ARE MORE THAN 500 FT.
4. ALL ENCLOSURES REQUIRE A MINIMUM OF EIGHT (8) INCHES OF CLEARANCE ON ALL SIDES
5. EQUIPMENT SUPPLIED BY A.R.E.: RESISTOR ENCLOSURES, VOLTAGE CLAMP, AND WINDY BOY 6000U INVERTERS; ALL OTHER EQUIPMENT PROVIDED BY CUSTOMER